

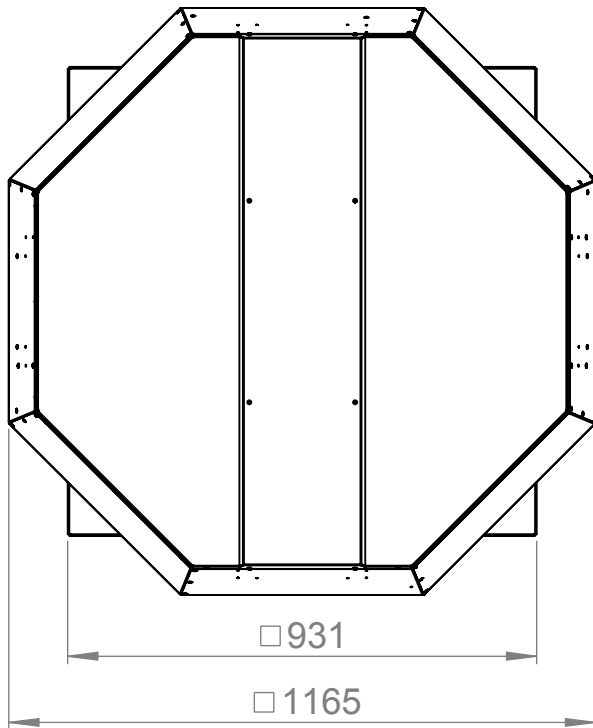


cable outlet

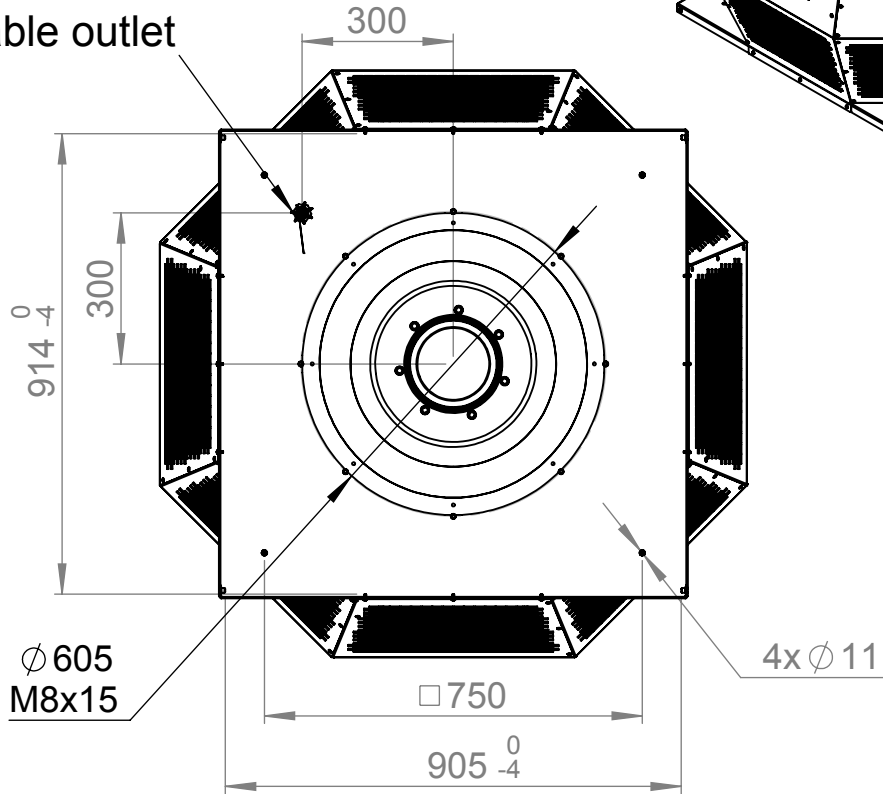

**ruck**<sup>eu</sup>  
VENTILATOREN  
ruck Ventilatoren  
Max-Planck-Str. 5  
D-97944 Boxberg



Protection Mark  
according to ISO 16016

Created I.benk  
Drawn I.benk  
Released v.brand  
Disabled

1:15 A4 mm

General tolerances  
DIN ISO 2768-c

26.11.2014  
26.11.2014  
15.07.2019

**DHA560D430+**

**131104 00**